


INSTALLATION INSTRUCTIONS

1. ENSURE THE APERTURE IS CLEAN, FREE OF DUST AND DEBRIS.
2. CUT THE RYANBATT 502 TO THE CORRECT SIZE TO FILL THE TRAPEZOIDAL PROFILE. ENSURE THE RYANBATT EXTENDS 100MM EITHER SIDE OF THE CORED APERTURE.
3. APPLY RYANFIRE BRUSH GRADE MASTIC TO WHERE THE RYANBATT WILL MATE WITH THE SURFACE OF THE FLOOR, AND TO ALL CUT AND EXPOSED EDGES OF THE RYANBATT.
4. SECURE RYANBATT 502 INTO POSITION USING 75MM CONCRETE ANCHORS AND PENNY WASHERS 50MM FROM THE EDGE AND AT CENTRES NOT EXCEEDING 200MM.
5. SEAL ANY GAPS AND JOINTS WITH RYANFIRE BRUSH GRADE MASIC.
6. APPLY RYANFIRE MASTIC TO THE JUNCTION BETWEEN THE PVC PIPE AND THE FLOOR / RYANBATT ON BOTH SIDES OF THE FLOOR.
7. SELECT THE CORRECT SIZE SL COLLAR AND FIT IT AROUND THE PIPE.
8. SLIDE THE COLLAR ALONG THE PIPE UNTIL IT IS HARD UP AGAINST THE UNDERSIDE OF THE FLOOR / RYANBATT 502.
9. FIX THE RYANFIRE SL COLLAR INTO POSITION USING A COMBINATION OF:
 - A. MINIMUM 32MM CONCRETE ANCHORS AND PENNY WASHERS FOR THE FLOOR PROFILE PEAKS.
 - B. MINIMUM 75MM CONCRETE ANCHORS AND PENNY WASHERS FOR THE FLOOR PROFILE TROUGHS.
10. FIXINGS MUST HAVE A MINIMUM 25MM EMBEDMENT INTO THE CONCRETE.
11. APPLY A NOMINAL 5MM BEAD OF RYANFIRE MASTIC TO THE JUNCTION BETWEEN THE SL COLLAR AND THE FLOOR / RYANBATT.
12. APPLY RYANFIRE HP-X INTO THE ANNULAR GAP BETWEEN THE COLLAR AND THE PIPE TO THE FULL DEPTH OF THE COLLAR.

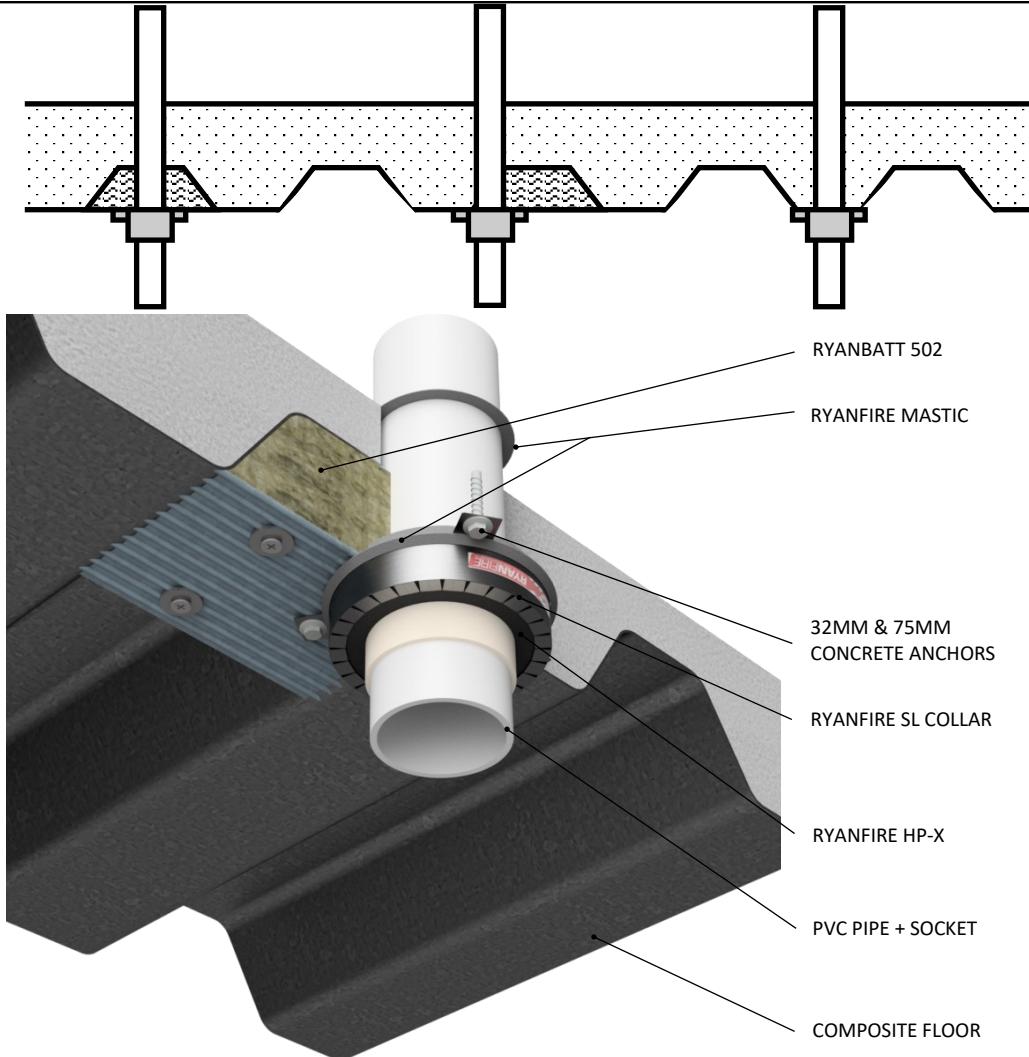

Please note:

Ryanfire Products owns and has copyright in these drawings. They are to be used only for the purpose for which they were intended and supplied and are not to be sold, transferred or made available for use by a third party.

Any misuse of these drawings will result in legal proceedings.

All errors and omissions excepted - the information contained within this drawing is believed to be correct on the date of publication, and is based upon tested and certified solutions. The policy of Ryanfire Products is one of constant improvement. Installers must therefore ensure that they are following the latest published drawings, test evidence and instructions. Whilst Ryanfire Products will endeavour to keep its publications up to date, the accuracy of the information contained within this drawing may be affected by pertinent changes in the law or regulatory requirements and alterations or amendments to the specification of the manufactured products. Terms and conditions of sale apply.

RYANFIRE Technical Support: info@ryanfire.co.nz - Tel 09 443 0362

Products:	RYANBATT 502 RYANFIRE SL COLLAR RYANFIRE HP-X RYANFIRE MASTIC RYANFIRE BRUSH GRADE MASTIC AS 1530.4/AS 4072.1
Approvals:	
BK:	134
Ref:	22SFR00027
ID:	G, H
Scenario:	Penetration seal to uPVC pipes + socket joint
Construction:	125mm composite floor
Services:	Up to Ø100mm uPVC pipes + socket joint
Fire Integrity:	90 minutes
Fire Insulation:	90 minutes

Web based drawings are for example only. Fire performance of any system is dependant on, but not limited to size of opening, substrate, if penetrations are passing through, type, size and number. Please refer to Ryanfire technical department for detailed and specific fire performance information.



Client

Job Title

Drawing Title

**SL Collar to uPVC pipes + socket
125mm Composite floor**

Scale	Date
NTS	July 2024
Sheet Size	Drawn By
A3	
Drawing Number	Rev
V23.19	2.0