


INSTALLATION INSTRUCTIONS

- 1. ENSURE THE APERTURE IS CLEAN AND FREE OF ANY DUST AND DEBRIS.
- 2. INSERT 2 LAYERS OF 50MM THICK RYANROCK 6050 INTO THE ANNULAR GAP AROUND THE CABLE BUNDLE, WITH THE FIRST LAYER FLUSH TO THE UNDERSIDE OF THE FLOOR.
- 3. APPLY RYANFIRE HP-X TO A DEPTH OF 50MM INTO THE ANNULAR GAP BETWEEN THE CABLE BUNDLE AND THE CONCRETE FLOOR. ENSURE THE GAP IS COMPLETELY FILLED UNTIL FLUSH WITH THE TOP SURFACE OF THE FLOOR.
- 4. REMOVE ANY EXCESS HP-X WITH A DAMP CLOTH.

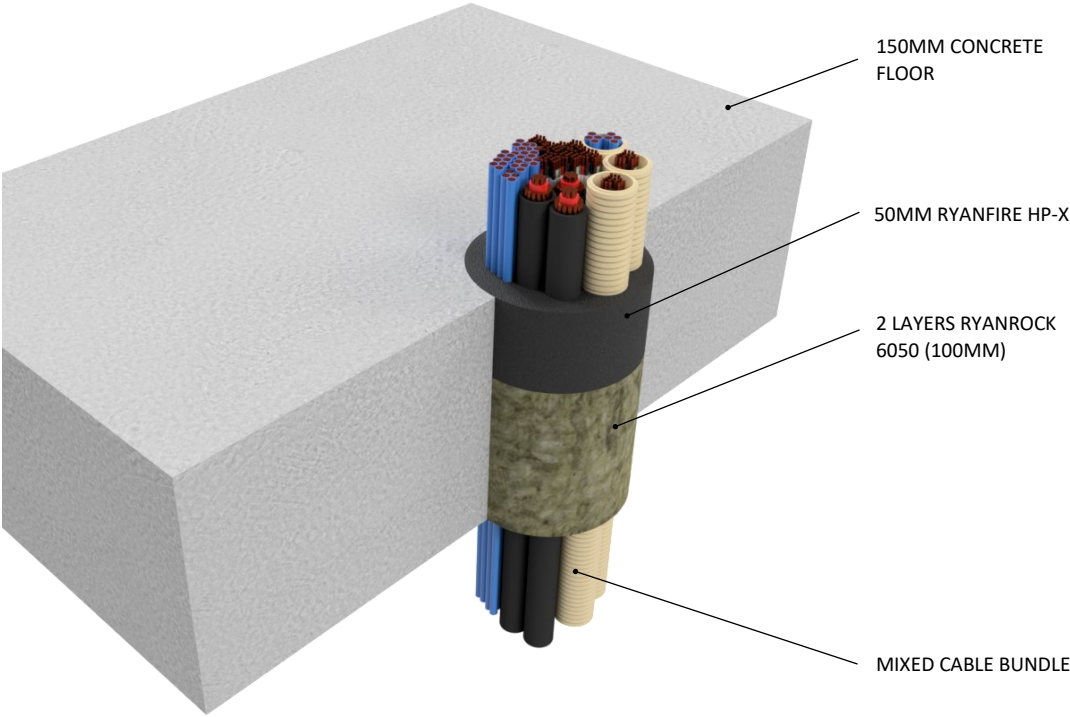

Products:	RYANFIRE HP-X RYANROCK 6050
Approval:	AS 1530.4/4072.1
BK:	207
Ref:	23SFR00007
ID:	D
Scenario:	Penetration seal to cable bundle
Services:	Up to Ø100mm cable bundle: 3 x Ø25mm flexi conduits 3 x 25mm ² mains TPS, Data
Annular:	25-35mm
Construction:	150mm concrete floor
Fire Integrity:	90 minutes
Fire Insulation:	90 minutes

Web based drawings are for example only. Fire performance of any system is dependant on, but not limited to size of opening, substrate, if penetrations are passing through, type, size and number. Please refer to Ryanfire technical department for detailed and specific fire performance information.



RYANFIRE Technical Support:
info@ryanfire.co.nz - Tel 09 443 0362

Drawing Title
**Ryanrock & HP-X to cable bundle
150mm concrete floor**

Scale	NTS	Date	July 2024
Drawing Number	V29.45	Rev	3.0

All errors and omissions excepted. The information contained within this drawing is believed to be correct on the date of publication, and is based upon tested and certified solutions. The policy of Ryanfire Products is one of constant improvement. Installers must ensure that they are following the latest published drawings, test evidence and instructions. Whilst Ryanfire Products will endeavour to keep its publications up to date, the accuracy of the information contained within this drawing may be affected by pertinent changes in the law or regulatory requirements and alterations or amendments to the specification of the manufactured products. Terms and conditions of sale apply.

Ryanfire Products owns and has copyright to these drawings. They are to be used only for the purpose for which they were intended and supplied and are not to be sold, transferred or made available for use by a third party. Any misuse of these drawings will result in legal proceedings.