


### INSTALLATION INSTRUCTIONS

1. ENSURE THE APERTURE IS CLEAN AND FREE OF DUST AND DEBRIS.
2. APPLY 10MM DEEP TRAFALGAR FYREFLEX INTO THE ANNULAR GAP BETWEEN THE PIPE AND THE WALL.
3. PLACE ONE HALF OF THE BLADERUNNER (WITH THE STICKER VISIBLE) AROUND THE PIPE AND UP AGAINST THE WALL.
4. SECURE THE BLADERUNNER IN PLACE WITH TWO M6 X 50MM CONCRETE ANCHORS, USING THE PRE-FORMED FIXING HOLES. DO NOT OVERTIGHTEN THE ANCHORS.
5. INSTALL THE SECOND HALF OF THE BLADERUNNER IN THE SAME WAY AS THE FIRST HALF.
6. REPEAT THIS PROCESS ON THE OPPOSITE SIDE OF THE WALL.

**NOTE: THE CABLE TIES FORM PART OF THE PRODUCT MECHANISM.**

**DO NOT CUT THE CABLE TIES**

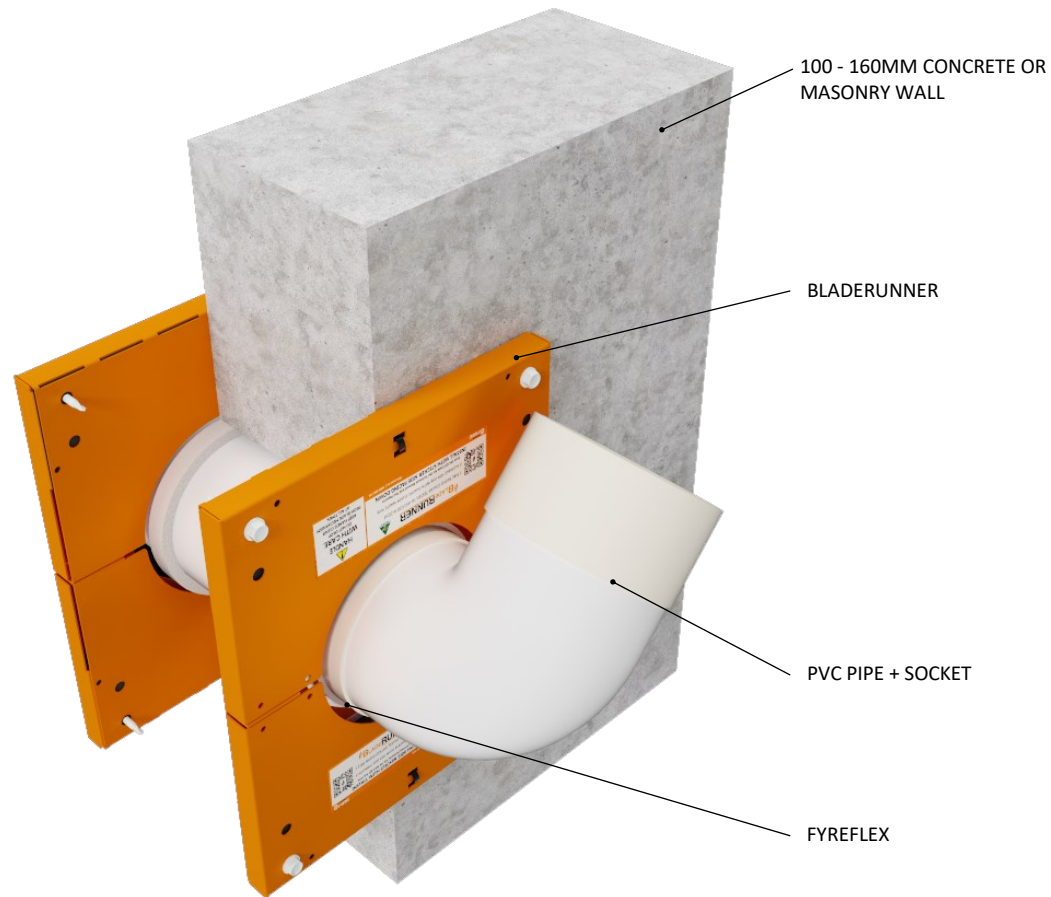

Products:	TRAFALGAR BLADERUNNER TRAFALGAR FYREFLEX
Approvals:	AS 1530.4:2014/AS 4072.1:2005
BK:	324
Ref:	FCO 3576
ID:	Table 2 / Table 3
Scenario:	Penetration seal to PVC pipes + socket joint
Services:	Ø100mm PVC pipe + socket joint
Annular:	2 - 6mm
Construction:	100 - 160mm concrete / masonry wall

#### Fire Resistance:

Wall thickness		FRL
Concrete	Masonry	
100mm	110mm	-/90/90
120mm	130mm	-/120/120
150mm	160mm	-/180/180

Web based drawings are for example only. Fire performance of any system is dependant on, but not limited to size of opening, substrate, if penetrations are passing through, type, size and number. Please refer to Ryanfire technical department for detailed and specific fire performance information.

RYANFIRE Technical Support:  
info@ryanfire.co.nz - Tel 09 443 0362

Drawing Title

**BladeRUNNER & FyreFLEX to PVC socket  
100mm - 160mm concrete/masonry wall**

Date	August 2025	Scale	NTS
Drawing Number	TF14.01	Rev	2.0

**All errors and omissions excepted.** The information contained within this drawing is believed to be correct on the date of publication, and is based upon tested and certified solutions. The policy of **Ryanfire Products** is one of constant improvement. Installers must ensure that they are following the latest published drawings, test evidence and instructions. Whilst **Ryanfire Products** will endeavour to keep its publications up to date, the accuracy of the information contained within this drawing may be affected by pertinent changes in the law or regulatory requirements and alterations or amendments to the specification of the **manufactured** products. Terms and conditions of sale apply.

Ryanfire Products owns and has copyright to these drawings. They are to be used only for the purpose for which they were intended and supplied and are not to be sold, transferred or made available for use by a third party. Any misuse of these drawings will result in legal proceedings.